



December 2017 Copper Basin Outages 9 Outages

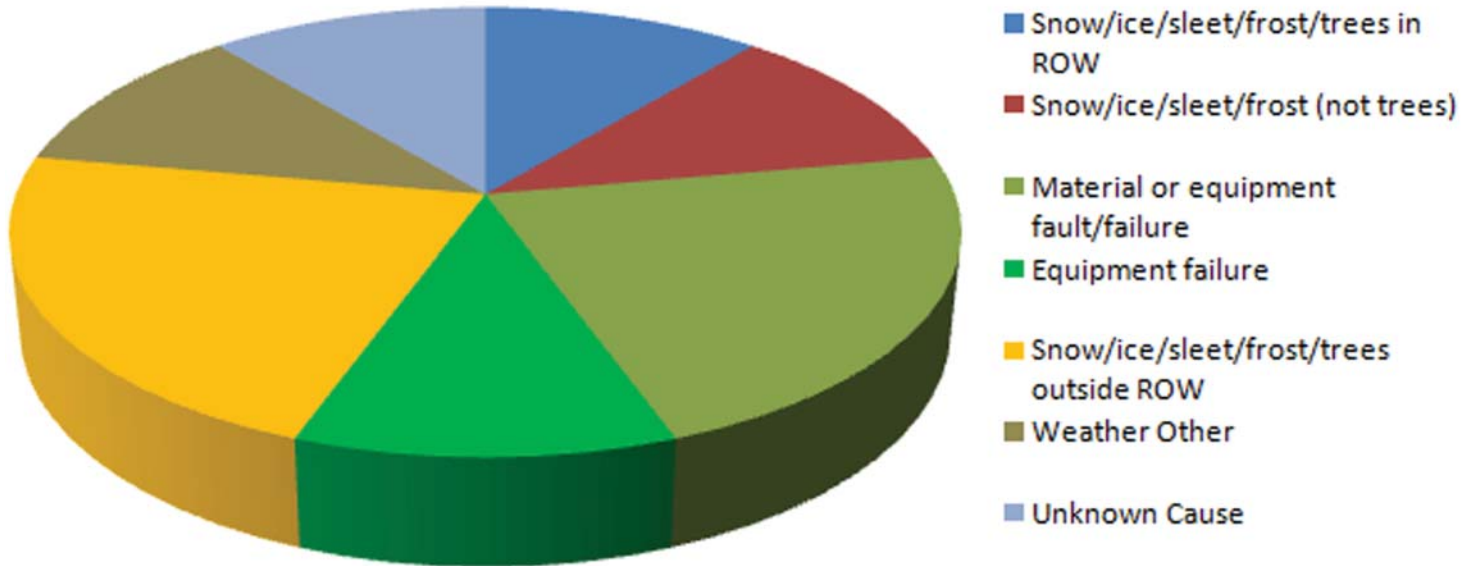


The majority of the outages from the storm that began on December 6 were restored by December 8. There were a number of single consumer outages between December 8 and 12 that were directly related to the storm event but were not reported until later for various reasons. The three outages affecting Mile 5 of the Old Edgerton highway on December 12 and 13 were related to the same issue. This event took place on three separate occasions, with the first two taking place during the night and were intermittent.


November 2017 Copper Basin Outages 3 Outages

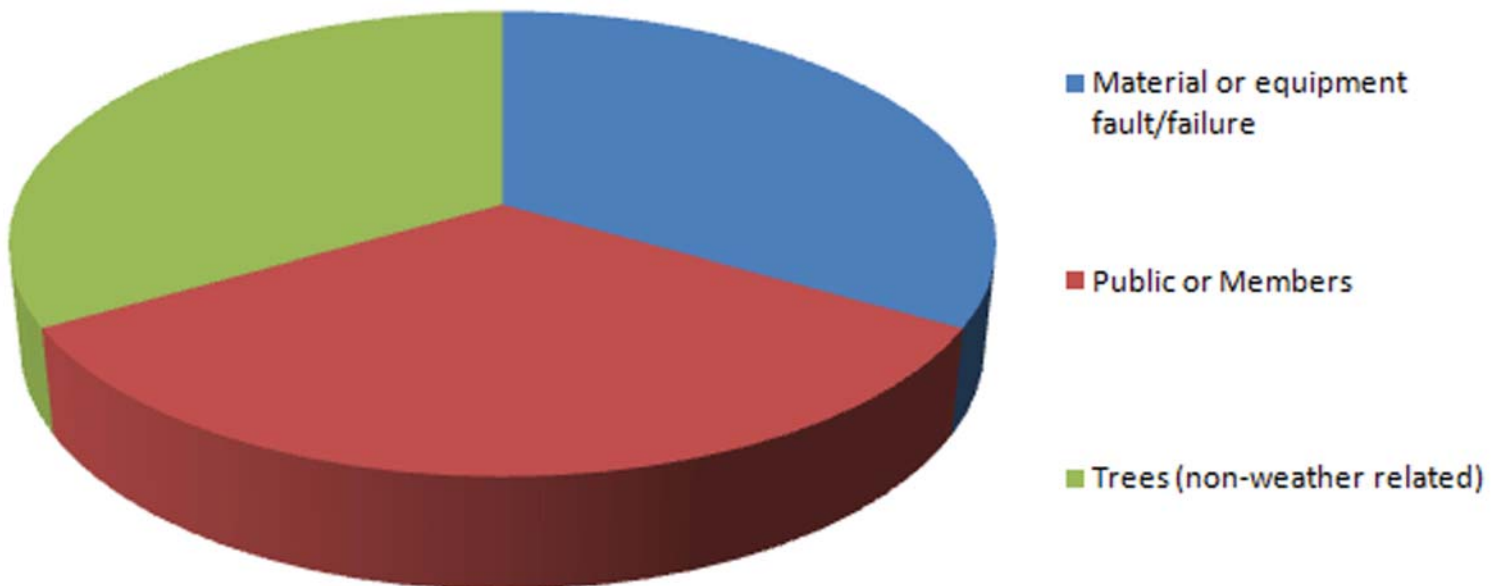


October 2017 Copper Basin Outages 11 Outages

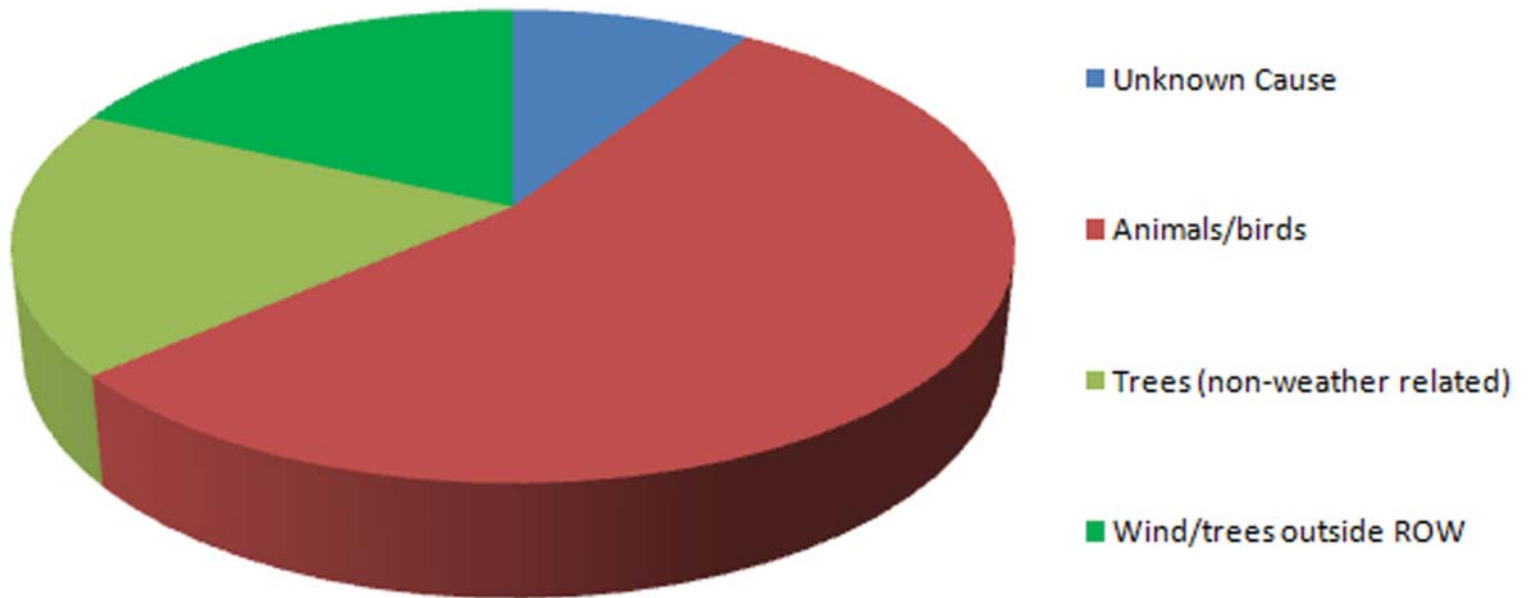

September 2017 Copper Basin Outages 3 Outages

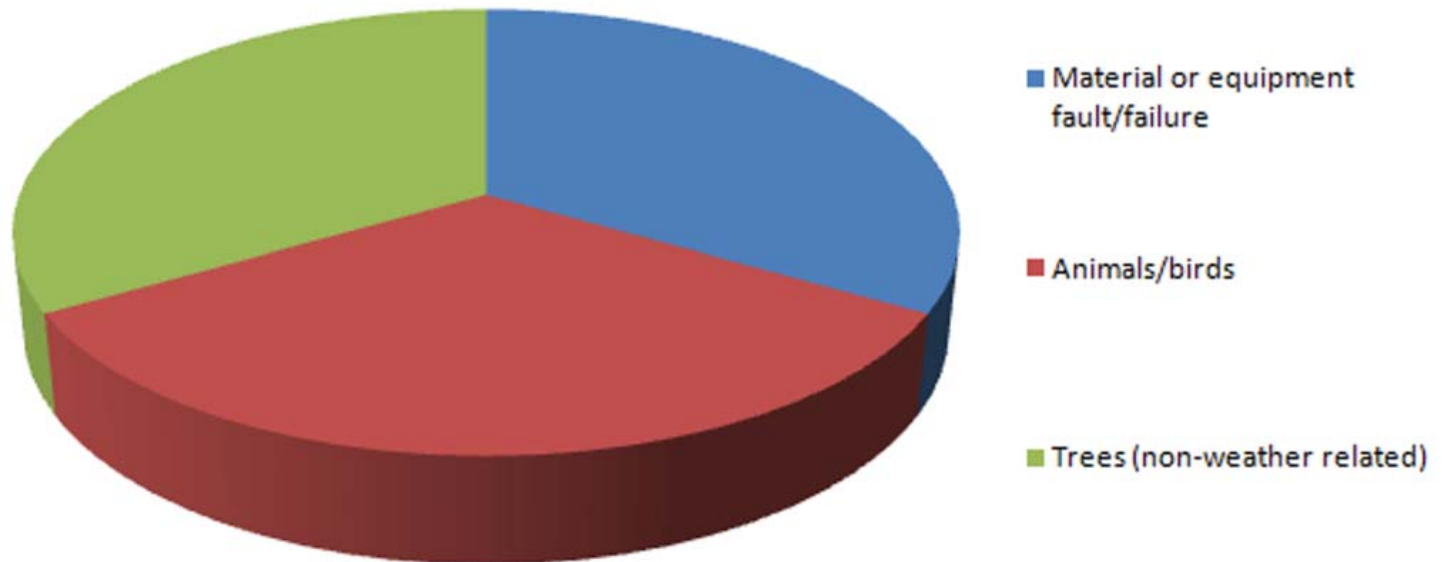


August 2017 Copper Basin Outages 12 Outages

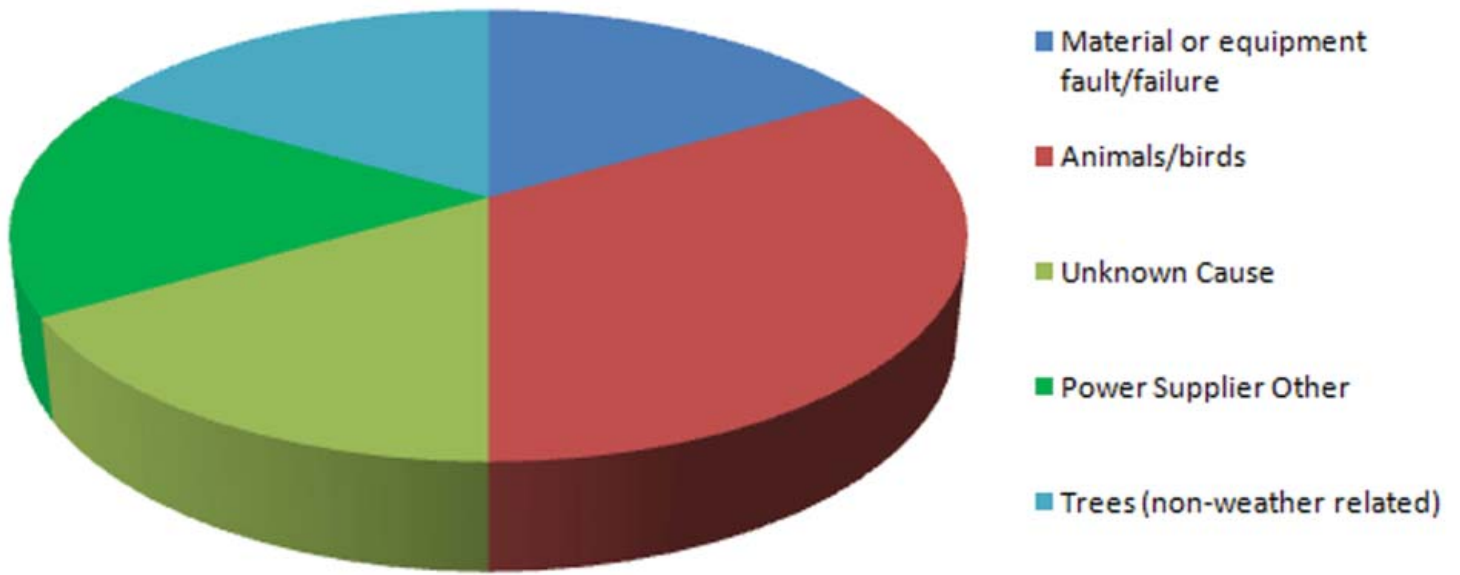


August 24 Allison Creek experienced a failure of one of the electrical components which caused the unit to trip offline causing the outage.


July 2017 Copper Basin Outages 4 Outages

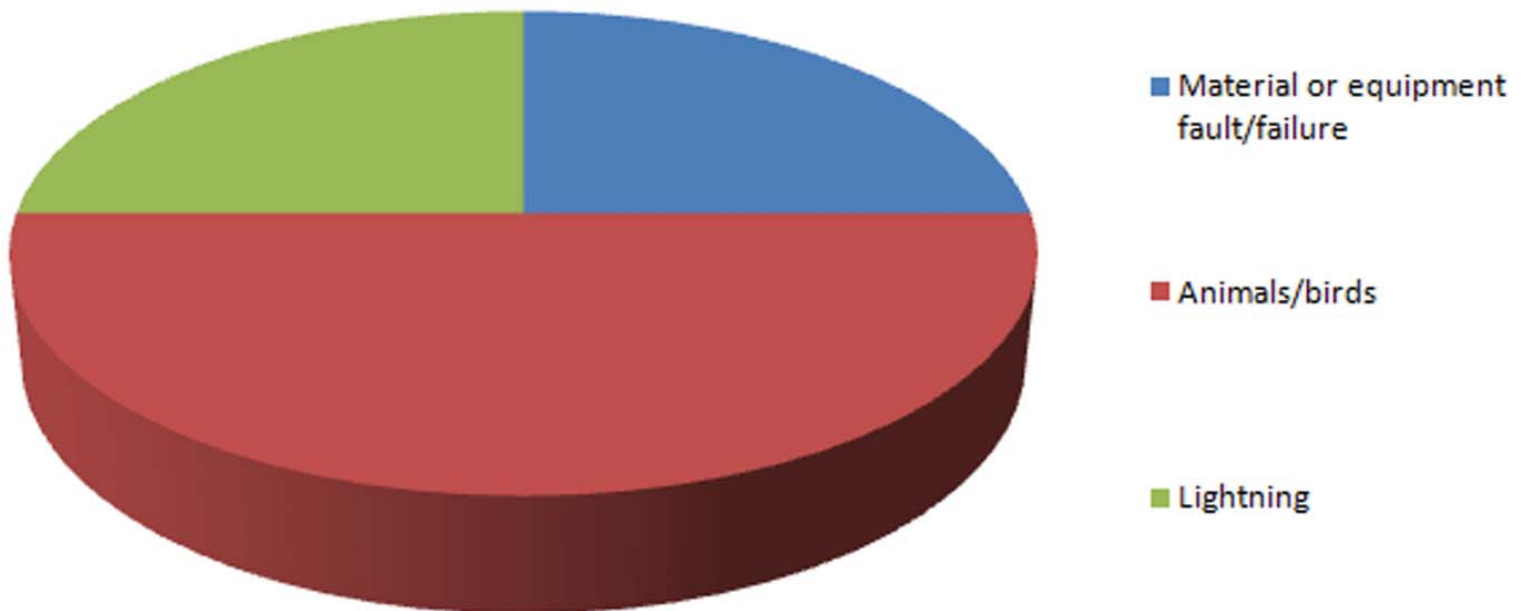

June 2017 Copper Basin Outages 6 Outages

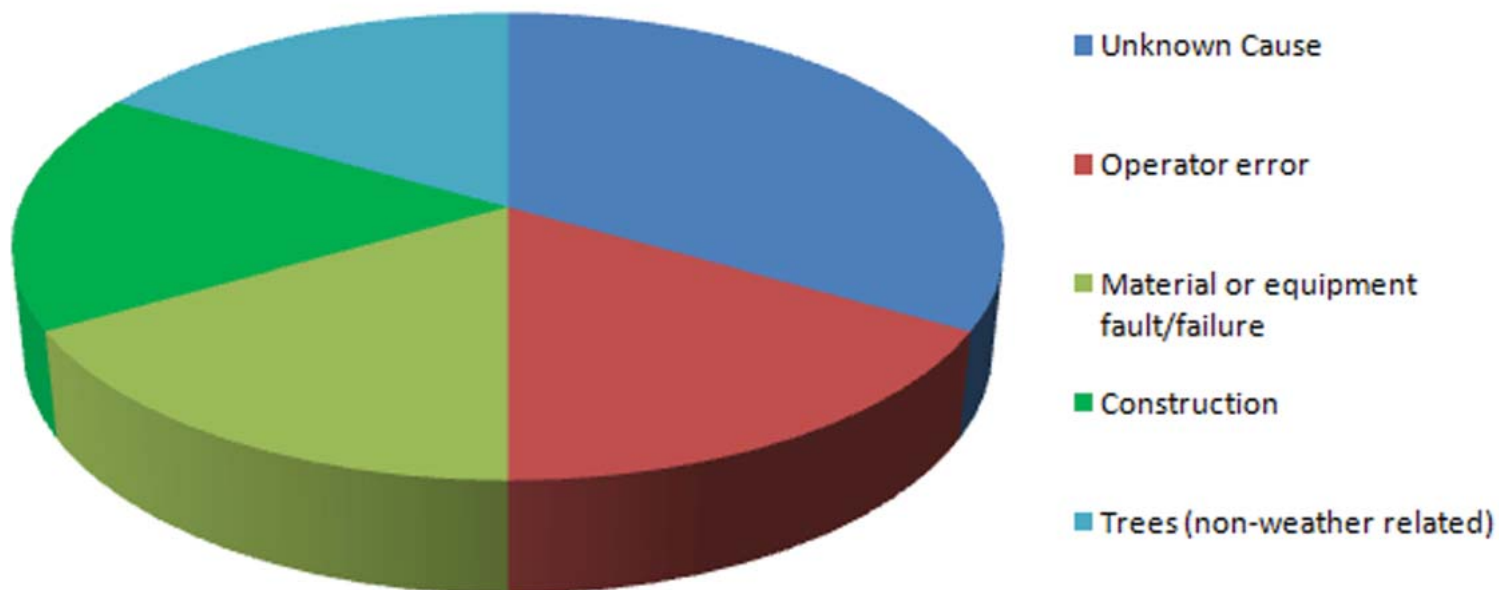


May 2017 Copper Basin Outages 7 Outages

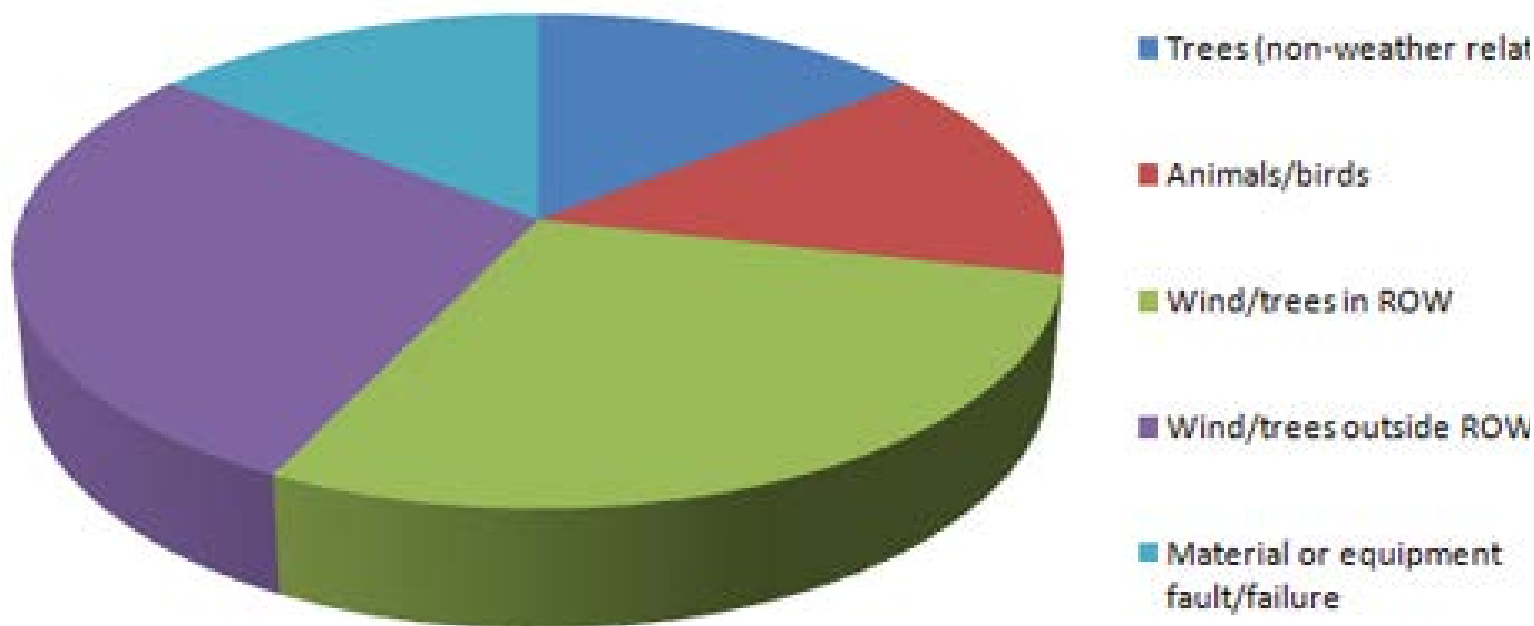


High winds contributed to a majority of the outages in the Copper Basin during the month of May.

April 2017 Copper Basin Outages 3 Outages

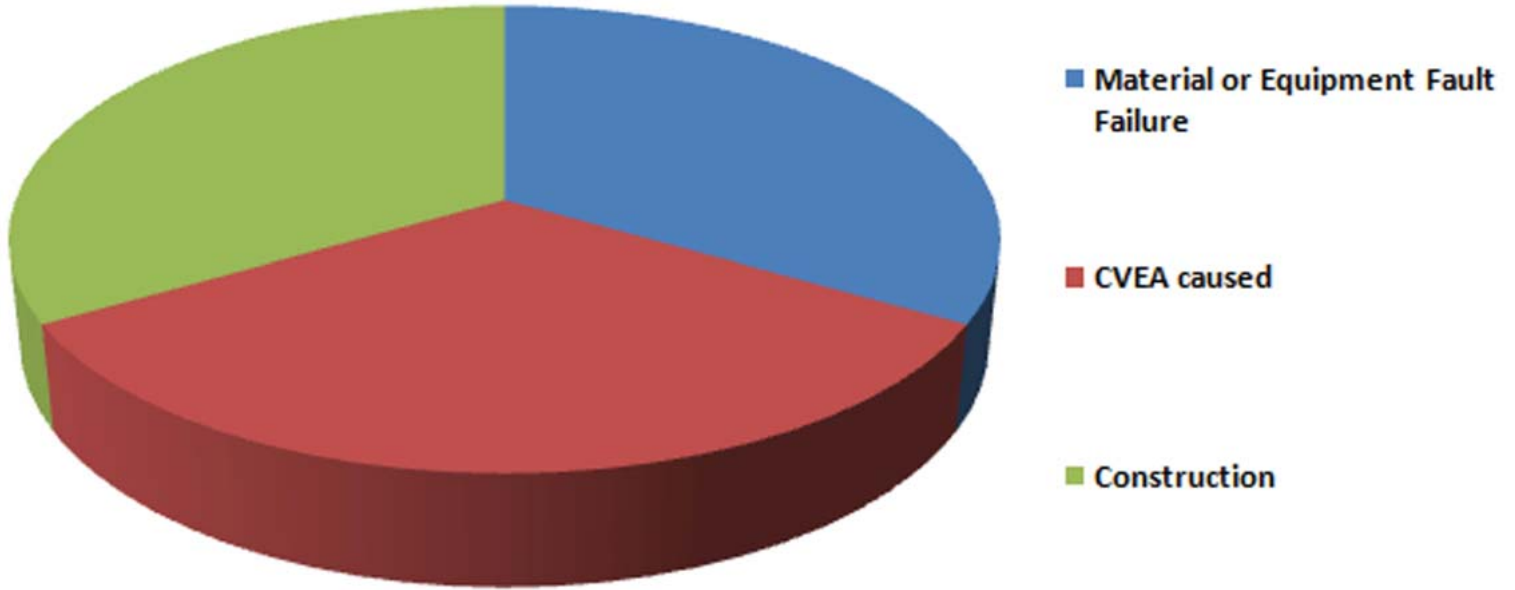


The system-wide outage on April 20 was due to a faulty section of underground conductor that was discovered while performing improvements at the Don Smith Substation

March 2017 Copper Basin Outages 2 Outages

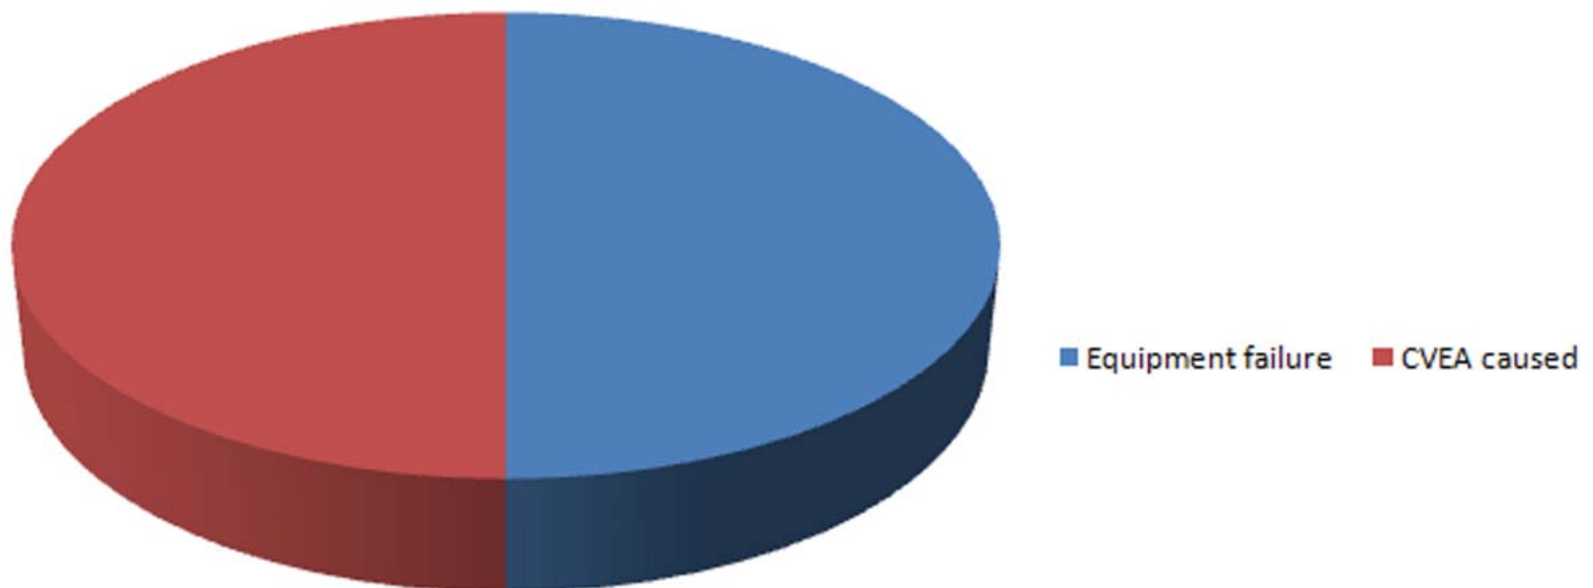

Equipment failure was a failed bearing on one of the Valdez Diesel Plant Generators.

February 2017 Copper Basin Outages 5 Outages

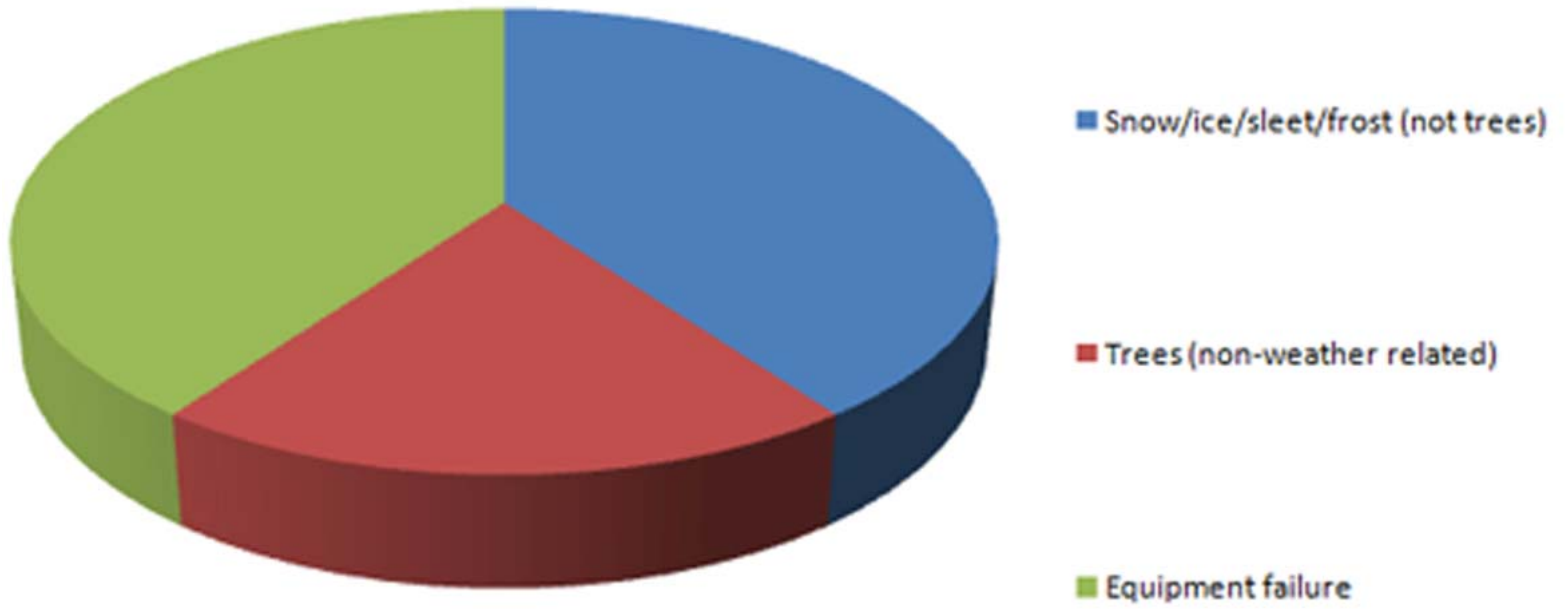

Two outages occurred during the same day due to a generator at the Glennallen Diesel Plant shutting down. The issue was resolved and the unit was placed back in service.

January 2017 Copper Basin Outages 4 Outages

